
Exhibit K. Tamanend Business Park East Site Electrical Distribution Infrastructure Map





Tamanend East Site Electrical Distribution Infrastructure Map

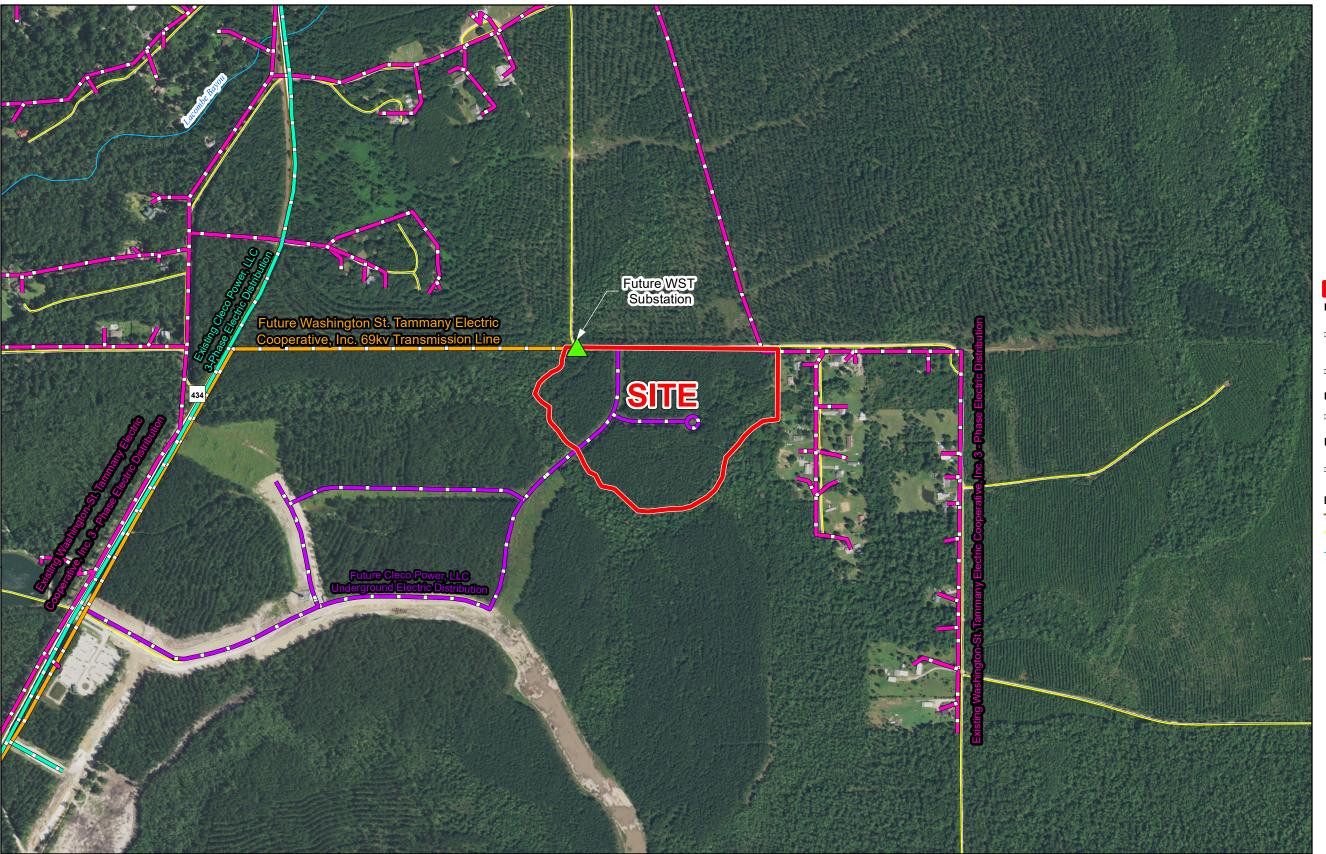

- 1. No attempt has been made by CSRS, Inc. to verify site boundary, title, actual legal ownership, deed restrictions, servitudes, easements, or other burdens on the property, other than that furnished by the client or his representative.

 2. Transportation data from 2013 TIGER datasets via U.S. Census Bureau at ftp://ftp2.census.gov/geo/tiger/TIGER2013.

 3. Utility information from visual inspection and/or the individual utility operators. Exact field location has not been determined by survey. The lines shown are an approximate representation only and may have been offset for depiction purposes.

 4. 2015 aerial imagery from USDA-APFO National Agricultural Inventory Project (NAIP) and may not reflect current ground conditions.
- 5. Location of future Washington St. Tammany Electric Cooperative, Inc transmission line and substation may vary. Actual location of substation is to be determined once a user is identified
- 6. Actual location of future Cleco Power, LLC underground distribution line contingent on future servitude agreement.

Existing Electric Distribution Tamanend East Site St. Tammany Parish, LA

St. Tammany EDF





St. Tammany Parish

LEGEND

Site Boundary (31.86 Ac. ±)

Existing Electric Distribution

- Existing Washington St. Tammany
- Electric Cooperative, Inc. 3 Phase Electric Distribution
- Existing Cleco Power, LLC 3 -Phase Electric Distribution

Future Electric Distribution

Future Cleco Power, LLC Underground Electric Distribution

Future Electric Transmission

Future Washington - St. Tammany Electric Cooperative, Inc. 69kv Transmission Line

Existing Roadway

- Rural State Highway
- Local Roads
- Stream



Date:	7/13/2016
Project Number:	214094
Drawn By:	TMK
Checked By:	JAY



Scale 1:8,000

Electric Utility Provider Survey (page 1 of 2)


Project ID

214094



05/17/2016

Provider Name: Cleco Power LLC

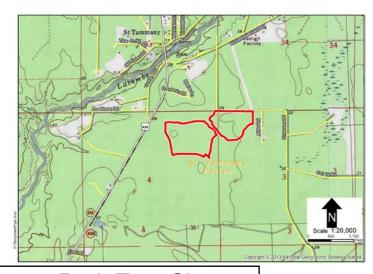

Site Map 1

Date:


needed basis.

Tamanend Business Park East Site Electrical Distribution Infrastructure Map

Name: Mike Sibley

Address:	P.O. Box 5000 Pineville, LA 71361-5000			Phone:	: 318-308-1273 mike.sibley@cleco.com			
City:				Email:				
State:	e: LA Zip Code: 71361-5000				Director - Economic Development			
ls electric di available at t	stribution currently this site?		Is 3-Phase s	service currently othis site?			al feed currently able to this site?	
Yes	○ No		Yes	○ No			es	
What is the s	ize of the nearest distr	ibution line	and distance (fe	eet) to the site?	Size (kV)	13.2	Distance 1,900	
•	not available at the site nree-phase line?	, what is the	size (kV) of and	d distance (feet) to	Size (kV)		Distance	
What is the s 69kV or grea	ize of and distance (mil ter?	es) to the ne	arest transmis	sion line with a	Size (kV)	230	Distance 2.1	
What is the d serve the site	listance (miles) to the nee?	earest subs	tation to	Distance 5.9	Name Hwy	1088		
What is the distance (miles) to the next closest substation to serve the site?				Distance 6.6	Name Bayo	u Bonfouca		
	urrent Peak Load capacit currently available to th		this site (MW)?	If no load informatio	n is available, pl	lease provide	Peak MW 6	
Is a plan und	derway to improve servi ementation.	ces at or nea	ar this site withir	n the next year? If so	o, please provid	de anticipated up	ogrades, location, an	

The portion of the 13.2 kV line between Hwy 1088 & Hwy 434 is constructed to 34.5 kV specifications with the anticipation of converting it to 34.5 kV voltage and adding substation near Hwy 434 (10,600 ft from site). However, this is not planned inside of a year but on an as

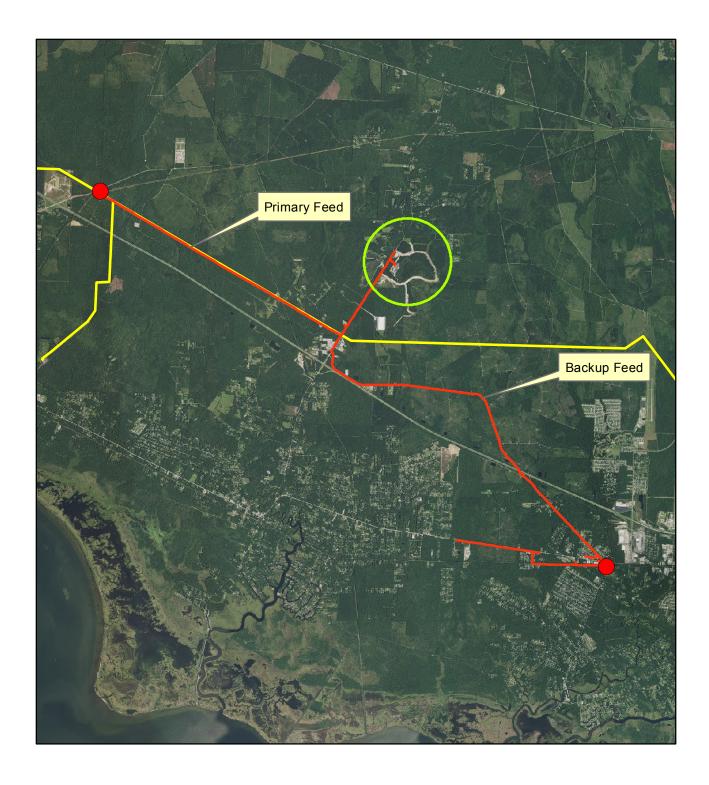

Legend



Substations



Electrical Lines



230 KV Transmission Lines




Electric Utility Provider Survey (page 1 of 2)

Project ID

214094



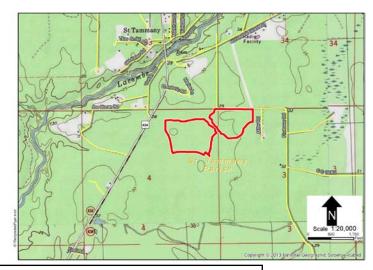

Site Map 1

Tamanend Business Park East Site Electrical Distribution Infrastructure Map

Date.	Way 17, 2010							
Provider Name:	Washington St. Ta	c Cooperative,	, Inc. Name	Bryan Jones				
Address:	950 Pearl St.		Phone	(985) 839-3562 x 592				
City:	Franklinton			Email:	bjones@wste.coop			
State:	LA Zip Code: 70438				Manager of Engi			
Is electric distribution currently Is 3-Phase service available at this site? available to this site				•			feed currently e to this site?	
Yes	○ No		Yes	○ No		Yes	○ No	
What is the size	of the nearest distr	ribution line a	nd distance (fe	eet) to the site?	Size (kV)	3.2	Distance 750	
If 3-phase is not the nearest thre	available at the site e-phase line?	e, what is the s	size (kV) of and	d distance (feet) to	Size (kV)		Distance	
What is the size 69kV or greater	of and distance (mi	les) to the nea	arest transmis	sion line with a	Size (kV)	9	Distance 5.9	
What is the dista	ance (miles) to the r	earest substa	ation to	Distance 1.8	Name Lacomb	oe .		
What is the distance (miles) to the next closest substation to serve the site?					Name Hickory	,		
	ent Peak Load capaci rrently available to th		this site (MW)?	If no load information	on is available, plea	se provide F	Peak MW 4.6	
			41.1 24 241.1					

Is a plan underway to improve services at or near this site within the next year? If so, please provide anticipated upgrades, location, and time for implementation.

Washington St. Tammany Electric is currently working toward construction of a 69 kV transmission line along Hwy 434. The distribution line will be upgraded to 559 ACAR which will increase the peak load capacity to 14 MW. Once the transmission line is complete, WST can construct a substation along the northern property line of the development should the load necessitate.

